

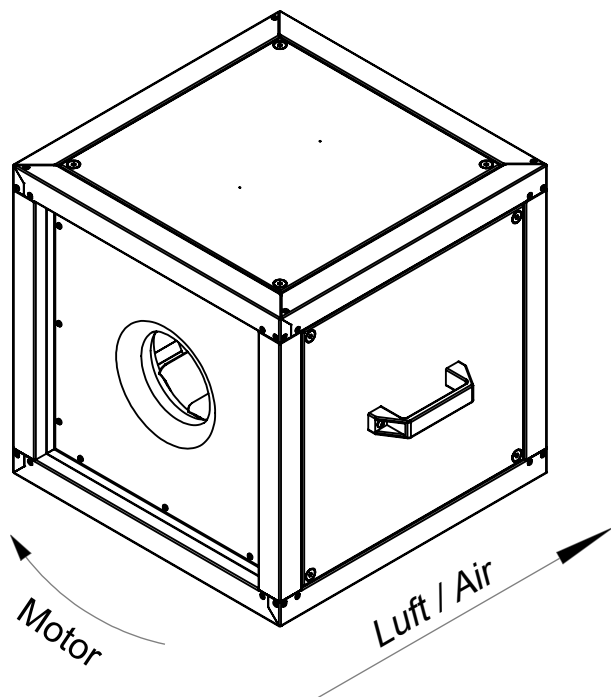


Anschlussmaß innen  
min.  $\varnothing$  195  
Connection size inside  
min.  $\varnothing$  195

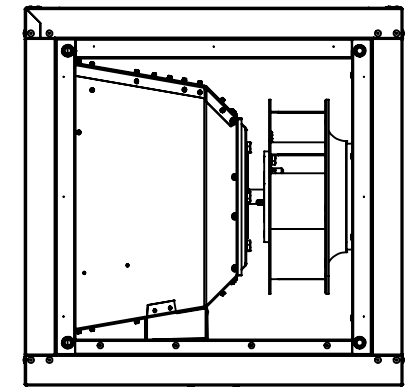

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg



Protection Mark  
according to ISO16016

Drawn: s.pop  
Created: p.guti  
Changed: s.pop

1:10 A4 mm

General tolerances  
DIN ISO 2768-c

**MPC225E2T21+**

**137885 02**

28.08.17  
08.11.16  
28.08.17